


SUDAS STANDARD SPECIFICATIONS

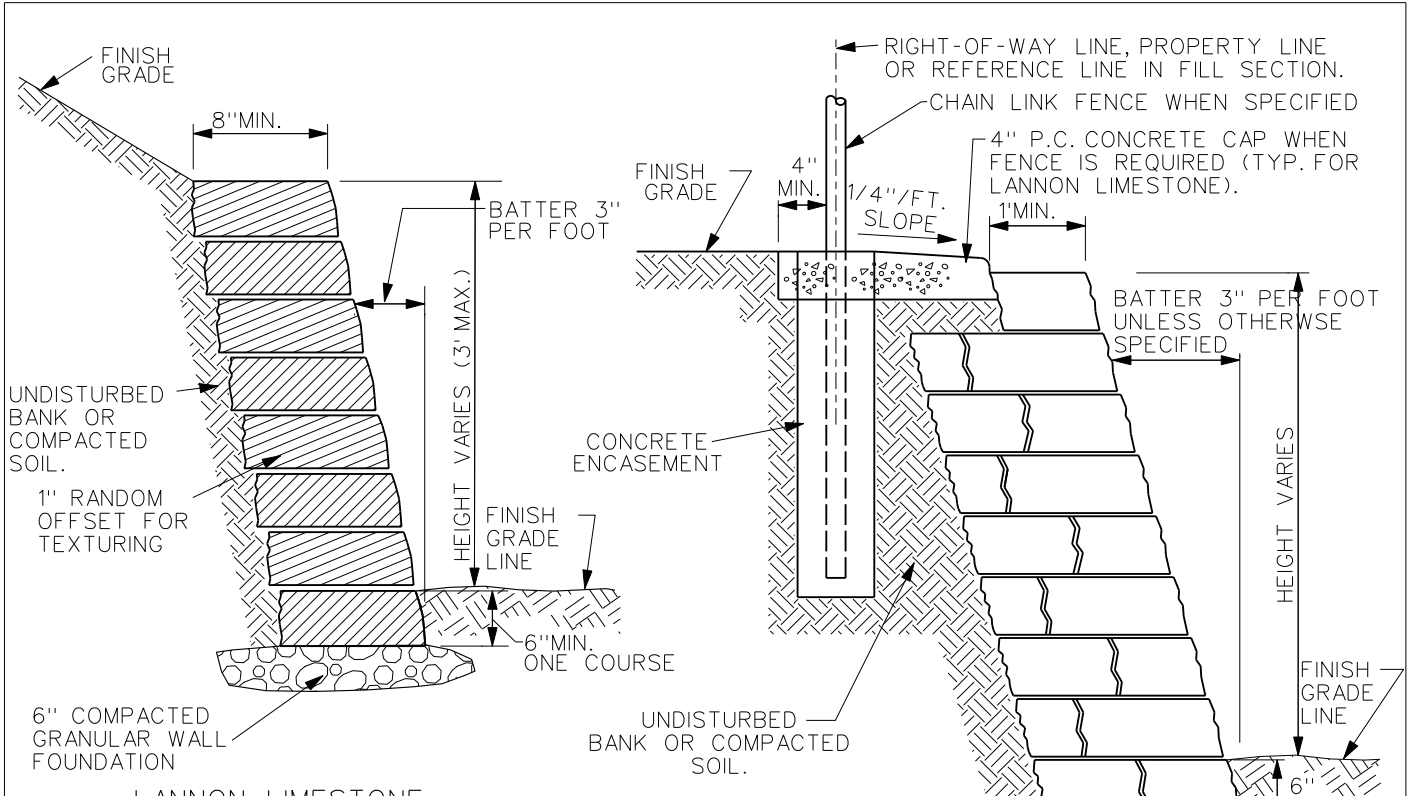


LANNON LIMESTONE

NOTES:

1. JOINTS SHALL BE 1/2" MAXIMUM THICKNESS FOR LIMESTONE WALLS AND 1" MAXIMUM THICKNESS FOR OTHER MATERIALS.
2. 4" P.C. CONCRETE CAP IS TO BE CONSTRUCTED, MEASURED AND PAID AS 4" P.C.C. SIDEWALK, TRANSVERSE TOOLED JOINTS SHALL BE CONSTRUCTED AT 4' SPACING.
3. CHAIN LINK FENCE IS TO BE CONSTRUCTED AND PAID FOR IN ACCORDANCE WITH SECTION 9060.
4. COURSES TO BE PLACED HORIZONTALLY.

BROKEN CONCRETE

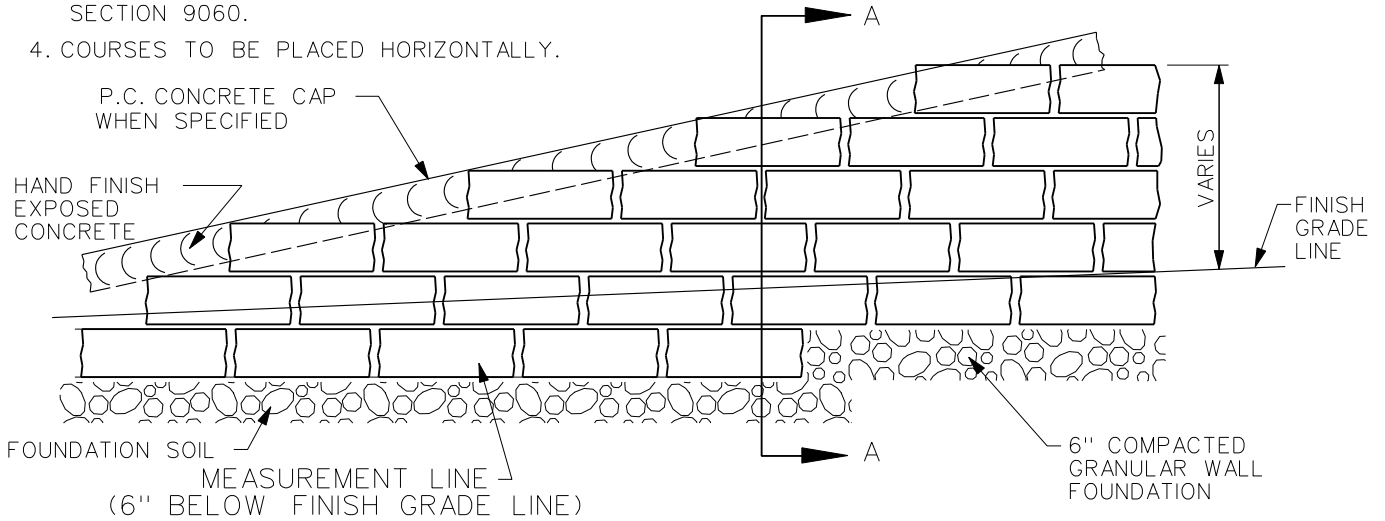

REV.	DATE	BY	DRY WALLS	FIGURE: 9070.1
DATE: 03-03-98				SHEET 1 OF 1