SUDAS Revision Submittal Form

Status Date:	As of 11/2/2026	**Topic:**	Class A sidewalk
Manual:	Specifications	**Manual Location:**	Figures 7030.201 and 7030.202

Requested Revision: *See attached.*


Reason for Revision: Including an additional sidewalk option.

Comments: None.

Region:	☒ Central	☐ East	☐ West
Comments:	Okay with adding new 6 inch option (need to remove reference to Figure 7030.202), but leave the other cross-section; need to revise the bid item. Perhaps change the left detail to 6 inches thick.		
Action:	☒ Tabled	☐ Not Approved	☐ Approved
Region:	☐ Central	☒ East	☐ West
Comments:	Add a type 1 and type 2 to the two different Class A options; also clarify the Figure 7030.202 reference on the new detail		
Action:	☐ Deferred	☐ Not Approved	☒ Approved
Region:	☐ Central	☐ East	☒ West
Comments:	For the original Class A detail, increase the sidewalk thickness to 6 inches; clarify reference to Figure 7030.202; add a type 1 and type 2		
Action:	☐ Deferred	☐ Not Approved	☒ Approved

Final Regional Action Summary: Only 2 of the regions approved; see comments above. *Note - after discussions at all regions, staff developed shifted all of the Class A sidewalk details to Figure 7030.201 and Class B and C sidewalks to Figure 7030.202.*

Board of Directors Action:

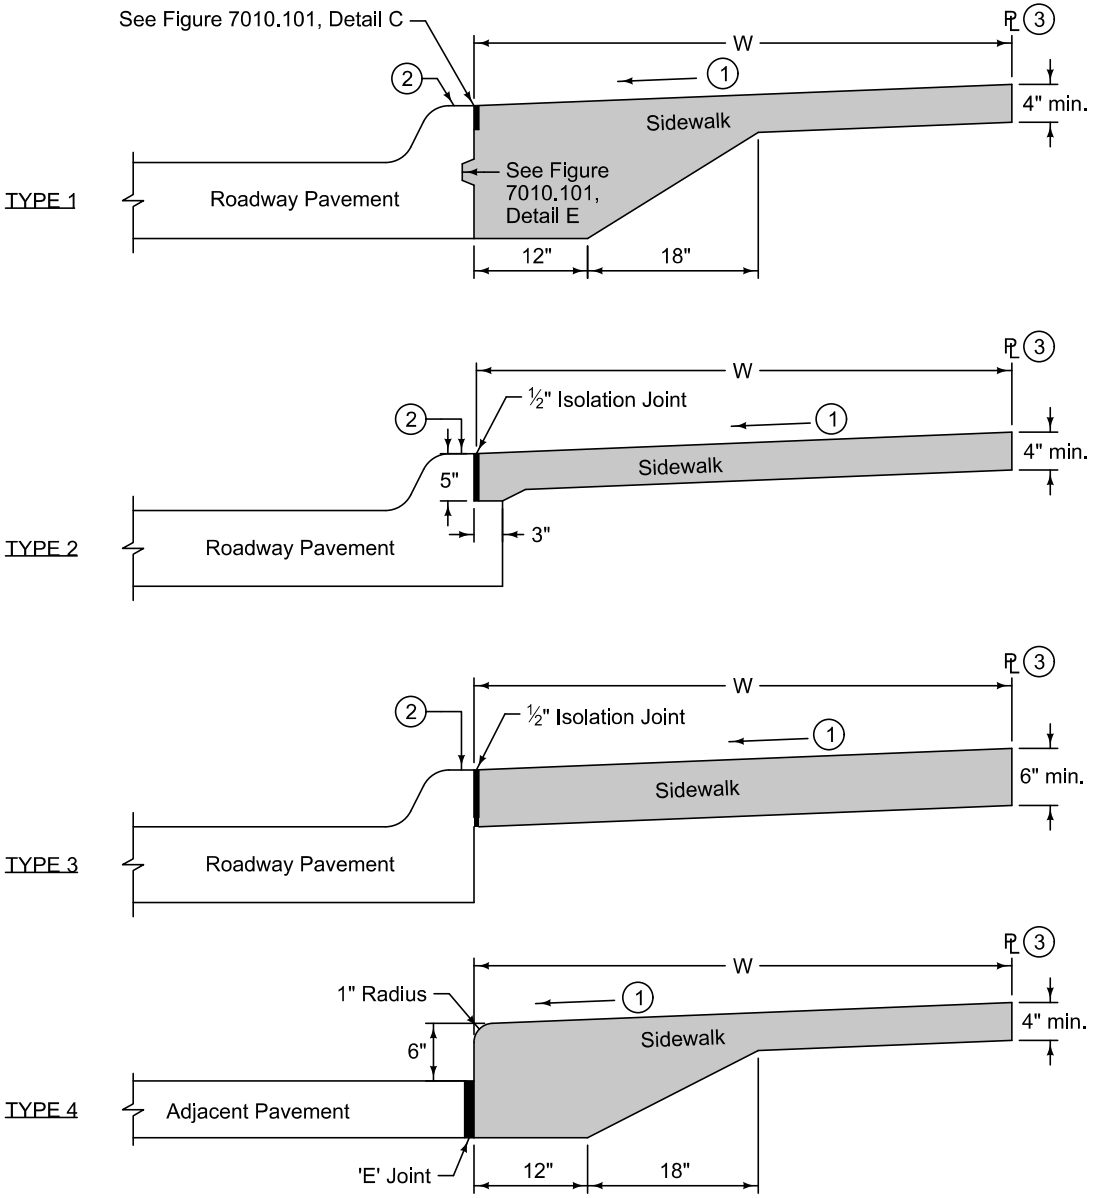

For new sidewalk with new curb and gutter, comply with Type 1, 2, or 3. For new sidewalk adjacent to existing pavement, comly with Type 3 or 4, or when specified in the contract documents.

(1) Target cross slope of 1.5% with a maximum cross slope of 2.0%.

(2) Ensure top of curb slopes to street for drainage.

(3) Sidewalk may or may not extend to adjacent property line. Provide isolation joint if sidewalk abuts building or other structure.

W = Sidewalk width as specified in the contract documents.

DRAFT

SUDAS

REVISION
4 | 2027 Edition


7030.201

SHEET 1 of 1


SUDAS Standard Specifications

CLASS A SIDEWALK

FIGURE 7030.201 | SHEET 1 OF 1

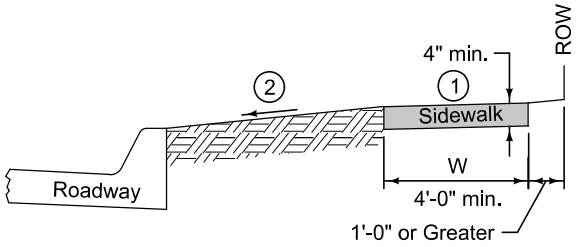

CLASS B SIDEWALK

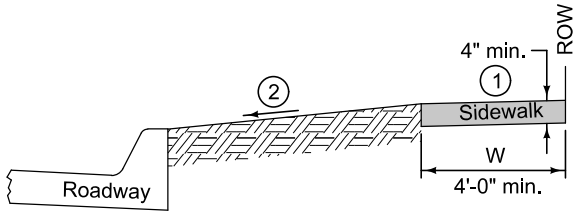

CLASS C SIDEWALK

(1) Target cross slope of 1.5% with a maximum cross slope of 2.0% (including sidewalk through driveway).

(2) Parking Slopes:
If parking width is less than 10 feet wide, slope at ¼ inch per foot.

If parking width is 10 feet wide and greater, slope at ½ inch per foot.

Special grade may be specified in the contract documents.

W = Sidewalk width as specified in the contract documents.

DRAFT

SUDAS

REVISION
4 | 2027 Edition

7030.202

SHEET 1 of 1

SUDAS Standard Specifications

CLASS B AND C SIDEWALKS

FIGURE 7030.202

SHEET 1 OF 1